


NOTE: THIS DRAWING IS PRELIMINARY. PLEASE REFER TO THE CERTIFIED BLUEPRINT FOR FINAL DIMENSIONS.


Horizontal	Inside	
Distance	Clearance	
1'	8'-5.5"	
2'	9'-4.5"	
3'	9'-10.5"	
4'	10'-3"	
5'	10'-7.5"	

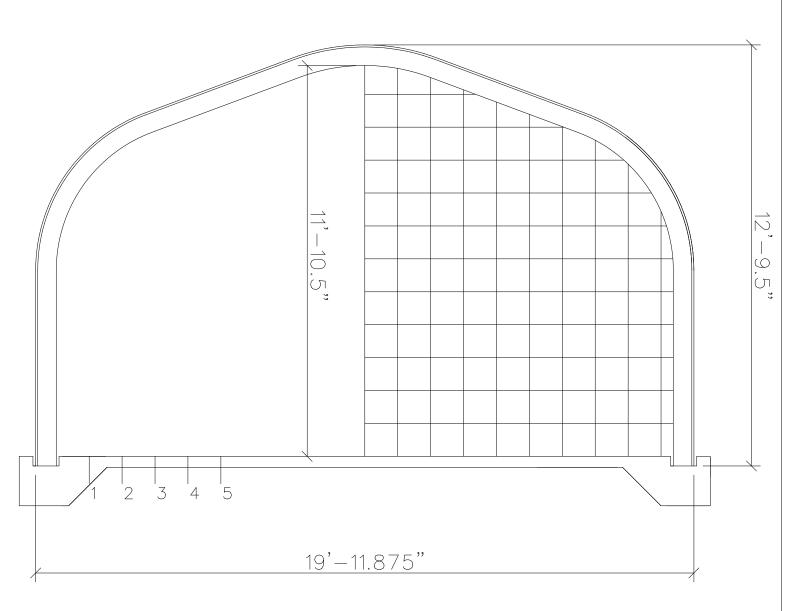


str. panels: 2@57.56	1 peak panel: 71.44	bolts/arch: 140	Date: 10/4/2022
2 eave panels: 92.25	str. wall panels: 2@71.44		
Endwall area, sq.ft: 254.47	Volume/ft, cu.ft: 249.34	Surface area/arch, sq.ft: 96.46	Total arch length: 459.94








### REAR ELEVATION



## SIDE ELEVATION




WARNING: DO NOT REMOVE OR REDUCE THE CONCRETE FLOOR OR THE REINFORCING STEEL, AND/OR RAISE THE TOPS OF THE FOOTERS ABOVE THE FLOOR OR BUILDING FAILURE MAY RESULT


3"


- Minimum Concrete Cover:
  (a) Concrete Cast against earth:
- (b) Concrete exposed to earth or weather:
  No. 6 through No. 10 bars:
  No. 5 bar and smaller:
  (c) Concrete not exposed to earth or weather:

### FRONT ELEVATION



ARCH PROFILE

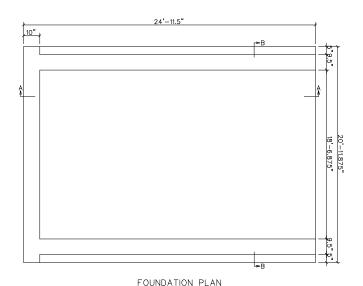

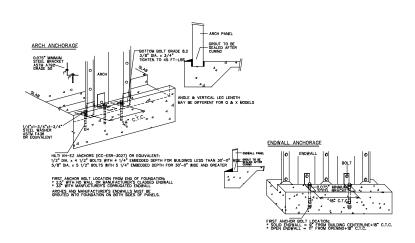

MINIMUM SEPARATION FROM THIS BUILDING TO ANY TALLER BUILDING MUST BE THE SMALLER OF 20 FEET AND 6 TIMES THE HEIGHT DIFFERENCE.

# FOUNDATION NOTES

AND/OR THIS DRAWING.

GENERAL NOTES

. ALL MATERIAL AND WORKMANSHIP SHALL CONFORM WITH THE REQUIREMENTS OF THE LATEST REVISION OF THE INTERNATIONAL BUILDING CODE 2006.
DESIGN ACCORDING TO NASPEC-01, NORTH AMERICAN SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL WEMBERS, AND WITH ANSI/ASCE 7-05.

2. NO LOADS OTHER THAN THOSE GIVEN UNDER "DESIGN DATA" BELOW SHALL BE IMPOSED ON THE "STRUCTURE" SPECIFIC NOTES AND DETAILS SHOWN ON THE DRAWINGS SHALL TAKE PRECEDENCE OVER THE BUILDING MANUAL SUPPLIED. 4. THE BUILDING, INCLUDING THE FOUNDATION, MUST BE CONSTRUCTED IN STRICT ACCORDANCE WITH THE DRAWING AND ERECTION INSTRUCTIONS. ANY DEVIATION, UNLESS APPROVED BY US IN WRITING, SHALL NULLIFY OUR CERTIFICATE AND SEAL AND SHALL BE THE SOLE RESPONSIBILITY OF THE ERECTOR. 5. A PROFESSIONAL ENGINEER SHOULD BE RETAINED WHERE SITE INSPECTIONS ARE WARRANTED.

NOTE: THE FOUNDATION ON THE DRAWING SPECIFIES THE MINIMAIM REQUIREMENTS. LOCAL BUILDING CODE AND SITE CONDITIONS MAY REQUIRE A STRONGER FOUNDATION, WHICH MUST BE DESIGNED BY A LOCAL ENGINEER. I. THE FOUNDATION SHALL BE FOUNDED ON NATURAL UNDISTURBED SOIL CAPABLE OF SAFELY SUSTAINING 1500 psf. THIS SHALL BE DESIGNED TO FULLY RESIST ALL ROTATION AT THE BASE OF THE ARCH. ALL NOTATION AT THE BASE OF THE ARCH.


SOL CAPABLE OF SUSTAINING 1500 pef WITHOUT


APPRECIABLE SETTLEMENT.

6. NO ARCH PANEL MAY BE CUT OR MODIFIED UNLESS IT IS TO ACCOMMODATE AN ACCESSORY PROVIDED BY THE MANUFACTURER IN ACCORDANCE WITH ITS INSTRUCTIONS

#### DESIGN DATA (MATERIALS)

L CONCRETE F'c = 2500 PSI @ 28 DAYS, ACI 2. REINFORCING STEEL GRADE 40, Fy = 40 KSI, ASTM A615 3. W.W.R. Fy = 65 KSL ASTM A185. 4. W.W.R. 6 x 6 - W1.4 x W1.4





Future Steel Buildings Intl. Corp.

A20-13