



2 SIDEWALL 'A' EXTERIOR ELEVATION
1 SCALE: 1/8" = 1'-0"

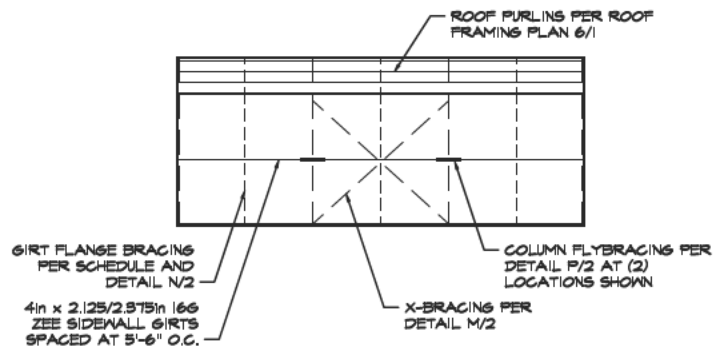

3 SIDEWALL 'B' EXTERIOR ELEVATION
1 SCALE: 1/8" = 1'-0"

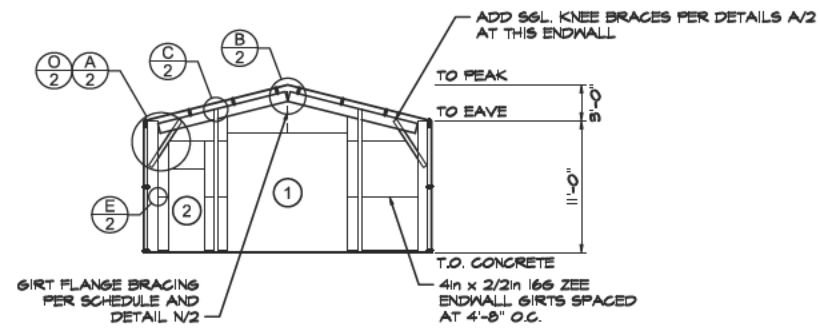


5 ENDWALL 'A' INTERIOR ELEVATION
1 SCALE: 1/8" = 1'-0"

DIAPHRAGM SCHEDULE


SHEETING IN DIAPHRAGM SECTIONS (SHOWN AS HATCHED AREA ON ELEVATIONS) NOT TO BE CUT UNDER ANY CIRCUMSTANCES

WALL	DISTANCE FROM WALL EDGE
Endwall 'B'	0.0'-24.0'

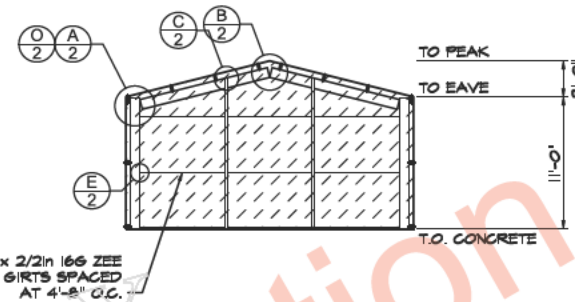


4 ENDWALL 'B' INTERIOR ELEVATION
1 SCALE: 1/8" = 1'-0"

ROOF DIAPHRAGM NOTE
ROOF SHEETING IS USED AS DIAPHRAGM TO BRACE THE BUILDING AND IS NOT TO BE CUT UNDER ANY CIRCUMSTANCES

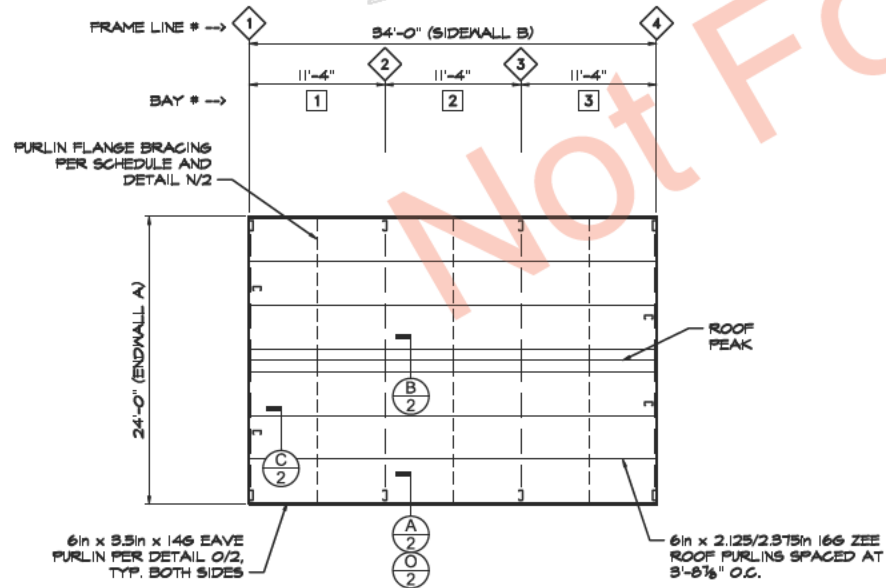

6 ROOF FRAMING PLAN
1 SCALE: 1/8" = 1'-0"

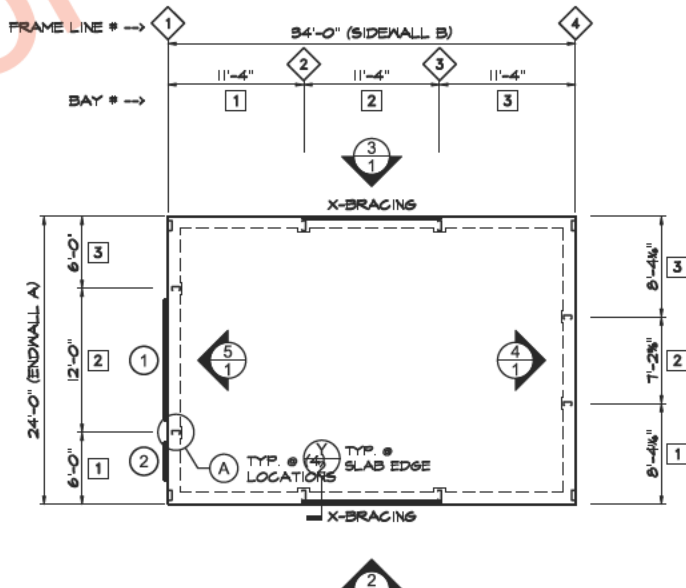

1 FOUNDATION PLAN
1 SCALE: 1/8" = 1'-0"

NOTE: USE 1/2" x 3" DEWALT SCREW-BOLT+ ANCHOR IN 3 1/2" DEEP HOLES AT ANCHOR LOCATIONS PER BASE DETAIL P/2, INSTALLED PER ICC REPORT ESR-3089, SECTION 4.5.

NOTE: SEE "TYP. FRAME CROSS-SECTION" DETAIL ON SHEET 2 FOR SPECIFIC FRAME DETAIL INFORMATION.

NOTE: EXCEPT AT DOOR OPENINGS, INSTALL L4x2x166 ANGLE TO FOUNDATION (FOR ATTACHMENT OF BOTTOM OF WALL SIDING) WITH 1/4in X 1 1/4in NAIL DRIVE MASONRY ANCHOR ANCHORS AT 48" O.C. (6" MAX. FROM ANY END).

IMPORTANT: IN ADDITION TO THESE PLANS (WHICH ALWAYS TAKE PRECEDENCE), YOU SHOULD HAVE THE FOLLOWING FROM ACT BUILDING SYSTEMS:

- CONSTRUCTION PACKAGE
- INSTALLATION MANUALS
- CONSTRUCTION VIDEOS

PLEASE CONTACT YOUR SALES REP IF YOU HAVE NOT RECEIVED THESE PRIOR TO STARTING CONSTRUCTION.

PROJECT DESIGN CRITERIA


BASED ON THE DIRECTIONAL DESIGN PROCEDURE OF ASCE 7-16, CHAPTER 27

SEISMIC DESIGN OF LATERAL FORCE-RESISTING SYSTEMS ARE AS FOLLOWS:

- TRANSVERSE: ORDINARY STEEL MOMENT FRAME (SEISMIC DESIGN IS BASED ON ASCE 07-16, SECTIONS 12.1 - 12.8)
- LONGITUDINAL: ORDINARY STEEL BRACED FRAME (SEISMIC DESIGN IS PERFORMED USING THE SIMPLIFIED DESIGN PROCEDURE (ASCE 07-16, SECTION 12.14).

DESIGN BASE SHEAR: IS SHOWN ON CALCULATION SHEET M2.

COMPONENT DIAGRAM

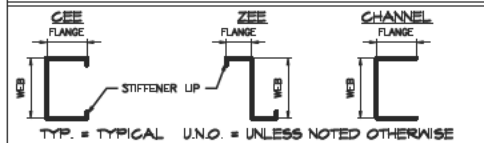

FOUNDATION DETAIL KEYS

(A) ENDWALL COLUMN (SEE DETAIL C/2 FOR TOP CONNECTION AND G/2 FOR BASE CONNECTION)

WALL OPENING SCHEDULE

DOOR	WIDTH	HEIGHT	OPENING TYPE	HEADER GIRT	OPENING JAMBS
1	10'-0"	10'-0"	SECTIONAL DOOR	SEE NOTE #4	C4X2.5 X16
2	3'-0"	7'-0"	PERSONNEL DOOR	SINGLE	CH4X 2X16

- NOTES:
- 1) JAMB MEMBERS SHOWN AS "CHN" ARE CHANNEL MEMBERS (WITHOUT STIFFENER LIPS) AND THOSE SHOWN AS "C" ARE CEE MEMBERS. FIRST NUMBER IS WEB DEPTH IN INCHES, SECOND NUMBER IS FLANGE WIDTH IN INCHES, AND THIRD NUMBER IS MATERIAL THICKNESS (GAUGE).
 - 2) SEE DETAILS J/2 AND K/2 FOR OPENING FRAMING INFORMATION.
 - 3) SIZE OF HEADER GIRT MEMBER TO BE SAME AS SIDEWALL OR ENDWALL GIRT, AS APPROPRIATE, PER ELEVATIONS. AT WINDOWS, INSTALL HEADER GIRT SPECIFIED ABOVE AND BELOW WINDOWS, U.N.O.
 - 4) AT OPENINGS NOTED, INSTEAD OF ATTACHING DOOR JAMBS TO HEADER GIRT PER DETAIL L1/2 ATTACH DOOR JAMBS TO UNDERSIDE OF KNEE BRACE PER DETAIL L2/2, ENDWALL RAFTER PER DETAIL L3/2.
 - 5) ALL OPENINGS AND ACCESSORIES SHALL BE CAPABLE OF SUPPORTING ALL WIND PRESSURES PERPENDICULAR TO THE SURFACE (GENERATED BY WINDS AT THE SPEED AND EXPOSURE INDICATED ABOVE) BY SPANNING BETWEEN THE JAMBS.

DEFLECTION LIMITS

PURLINS:	L/150 (STD)
GIRTS:	L/90 (STD)
EN WIND COLUMNS:	L/120 (STD)
WALL PANEL:	L/60 (STD)

PRELIMINARY
ONLY NOT FOR
CONSTRUCTION



ACTBUILDING
SYSTEMS

DISTRIBUTOR: Toro Steel Buildings
JOB NAME: Toro Steel Buildings
JOB ADDRESS: 801 Broadway Avenue NW
Grand Rapids, MI 49504

DRAWN

CHECKED

DATE 10/29/2024

JOB NO. VNUJ98563015

SHEET

1 OF 1